


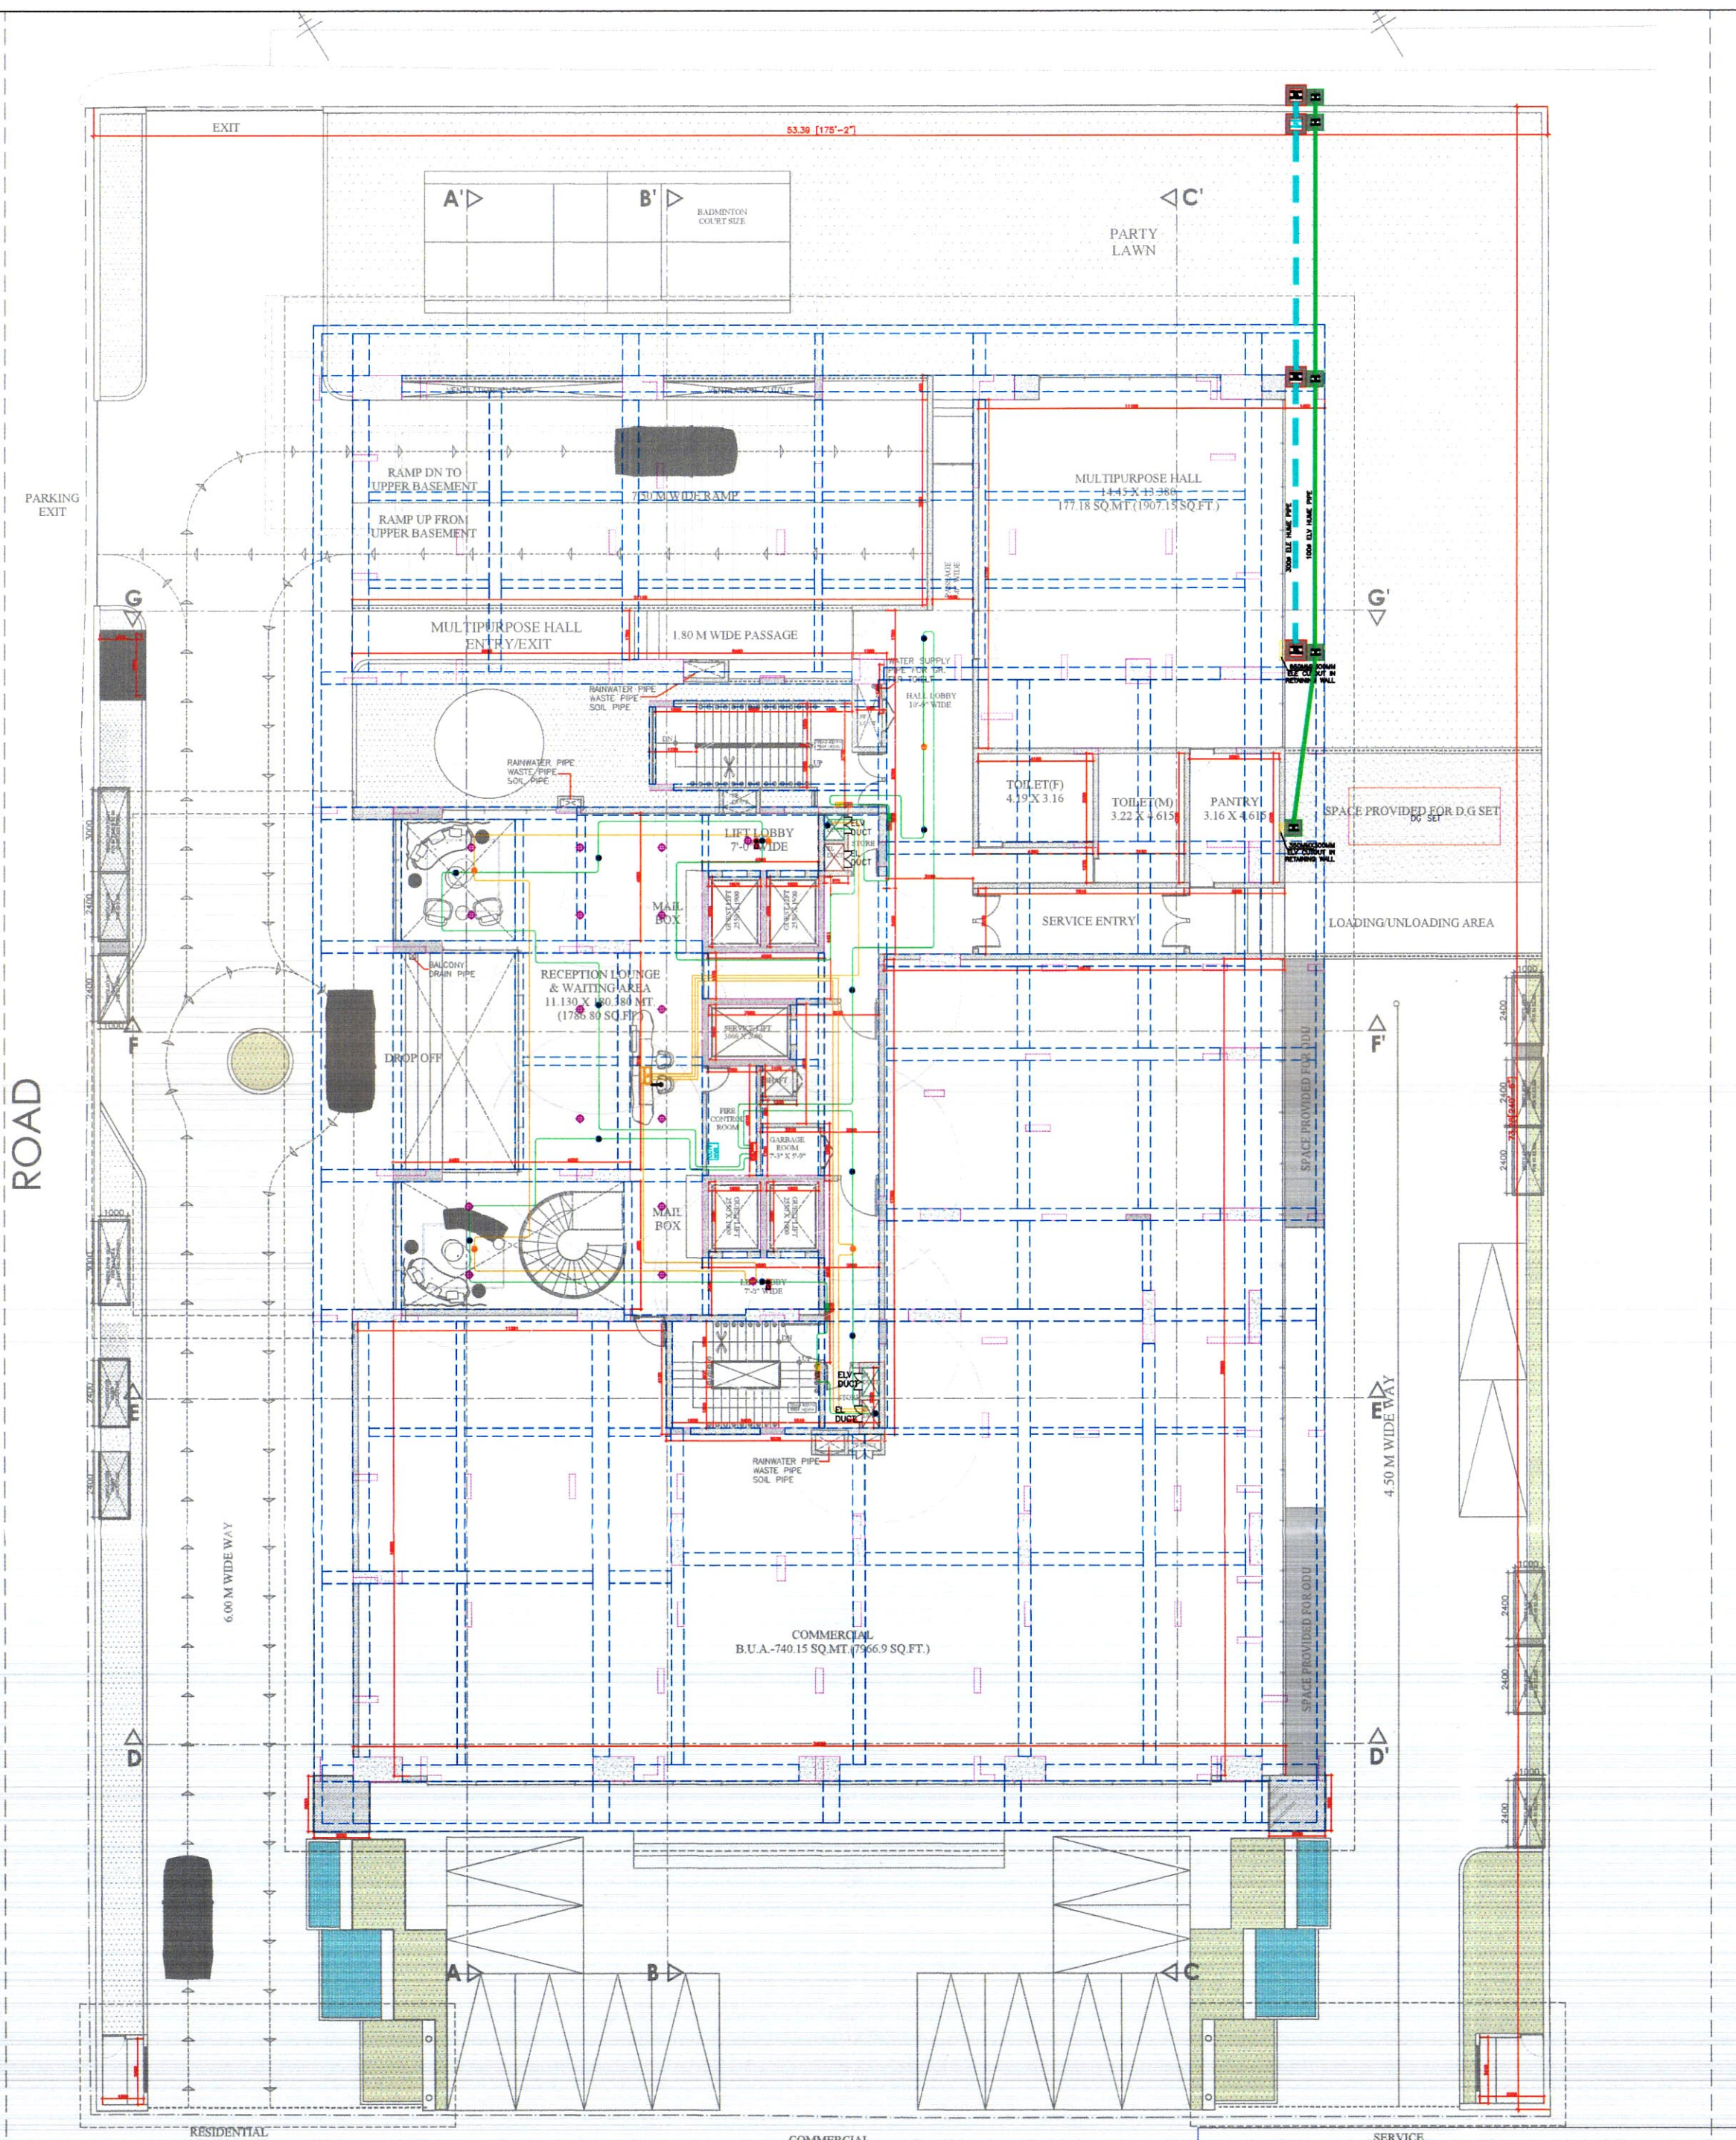

Mahendra Singh Shekhawat
Mahendra Singh Shekhawat
Chartered Engineer (India)
M.E. (Structure), B.E. (Civil)
M-1594421

ELECTRIC LEGEND	
	450mm X 450mm ELECTRICAL CHAMBER
	300mm X 300mm LV CHAMBER
	300ø ELE HUME PIPE
	100ø ELV HUME PIPE

LEGEND	
	6W CEILING SPEAKER
	10W WALL MOUNTED SPEAKER
	AMPLIFIER
	PUBLIC ADDRESS LOOPING

LEGEND	
	SMOKE DETECTOR (BELOW CEILING)
	SMOKE DETECTOR (ABOVE CEILING)
	RESPONSE INDICATOR
	MULTI DETECTOR
	HEAT DETECTOR
	MANUAL CALL POINT
	FLASHER & HOOTER
	CONTROL MODULE
	MONITOR MODULE
	FIRE MEN'S TELEPHONE JACK
	POWER SUPPLY UNIT
	ZONAL ADDRESSABLE MODULE
	FIRE ALARM LOOPING
	ADDRESSABLE FIRE ALARM PANEL
	CONVENTIONAL FIRE ALARM PANEL

NOTE - SMOKE DETECTOR (ABOVE CEILING)
REQUIRED FOR FALSE CEILING MORE THAN
800MM

- NOTES:
1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED.
 2. ALL LEVELS INDICATED ARE IN METERS UNLESS OTHERWISE SPECIFIED.
 3. ONLY METERS DIMENSIONS ARE TO BE FOLLOWED. DO NOT SCALE THE DRAWING.
 4. DIMENSIONS / LEVELS SHOWN TO BE VERIFIED AT SITE BEFORE COMMENCEMENT OF WORKS AND DISCREPANCIES IF ANY ARE BROUGHT TO THE NOTICE OF ARCHITECT IMMEDIATELY TO THE COMMENCEMENT OF WORKS.
 5. RELAYING EXISTING DIMENSIONS ARE TO BE READ IMMEDIATELY AND PROVISION OF DIMENSIONS TO BE PROVIDED TO THE ARCHITECT IMMEDIATELY.
 6. ALL PIPES SHALL BE PROVIDED TO 75 DIA. OR LESS & 1.5E TO 1.0E DIA. UNLESS OTHERWISE SPECIFIED.
 7. ALL PIPES SHALL BE TESTED WITH 3M HEIGHT WATER HEAD MAINTAINED FOR 24 HOURS.
 8. THE CONTRACTOR SHALL BE RESPONSIBLE IN ALL INTERFERENCE POINTS OF EXISTING UTILITIES.
 9. SLOVED SHALL BE PROVIDED FOR ALL PIPES PASSING THROUGH WALL, FLOOR OR PARTITION FITTED INTO PLACE AT THE TIME OF CONSTRUCTION.
 10. ALL SUPPLY LINES SHALL BE COVERED.
 11. ALL WATER SUPPLY LINES SHALL BE PROVIDED ABOVE GROUND AND G FOR EXISTING UTILITIES.
 12. ALL HOT WATER PIPING A FITTING SHALL BE FULLY INSULATED WITH CLOSED CELL POLYURETHANE THERMAL INSULATION WITH MINIMUM 25MM THICK WALL THICKNESS.
 13. SLOPE OFF VALUES FOR HOT & COLD WATER LINES SHALL BE PROVIDED ON FLOORING FINISHING CONTROL FOR ITS MAINTENANCE.
 14. ALL PIPES SHALL BE SUPPORTED & SECURED PROPERLY AT INTERVALS.
 15. ALL PIPES SHALL BE SUPPORTED & SECURED PROPERLY AT INTERVALS.
 16. ALL VALVES SHALL BE ACCESSIBLE FOR MAINTENANCE.

LEGEND & SYMBOLS :

NO.	FOR RERA SUBMISSION	27/01/2026	NO.	MR.	MB
REV.	DESCRIPTION	DATE	DATE	DATE	DATE
RECEIVER'S SIGNATURE					
PROJECT:					
PROPOSED BUILDING FACADE IN JLN MARG, JAIPUR					
Novante- Plot No. 03, Govind Marg, Fateh Teeba, Adarsh Nagar, Jaipur, Rajasthan					
PURPOSE OF RELEASE:					
FOR RERA SUBMISSION					
KEY PLAN					
MEP CONSULTANT:					
ARKK consulting Pvt Ltd.					
101, BECCAN VIHAR, BHAYAN SHANKAR ROAD, BHAYAN (V), BHAYAN - 400 025.					
E-mail: rnj@arkkconsulting.com					
DRAWING TITLE:					
JLN MARG - JAIPUR ELECTRICAL & ELV LAYOUT GROUND FLOOR					
DRAWN BY	ANTARA	DATE	27/01/2026	SIGN	
CHECKED BY	NAYAN	DATE	27/01/2026		
APPROVED BY	MILIND	DATE	27/01/2026		
DRAWING NO.	JLN/ARKK/ELE & ELV-504	SCALE	1:100	REV	RD