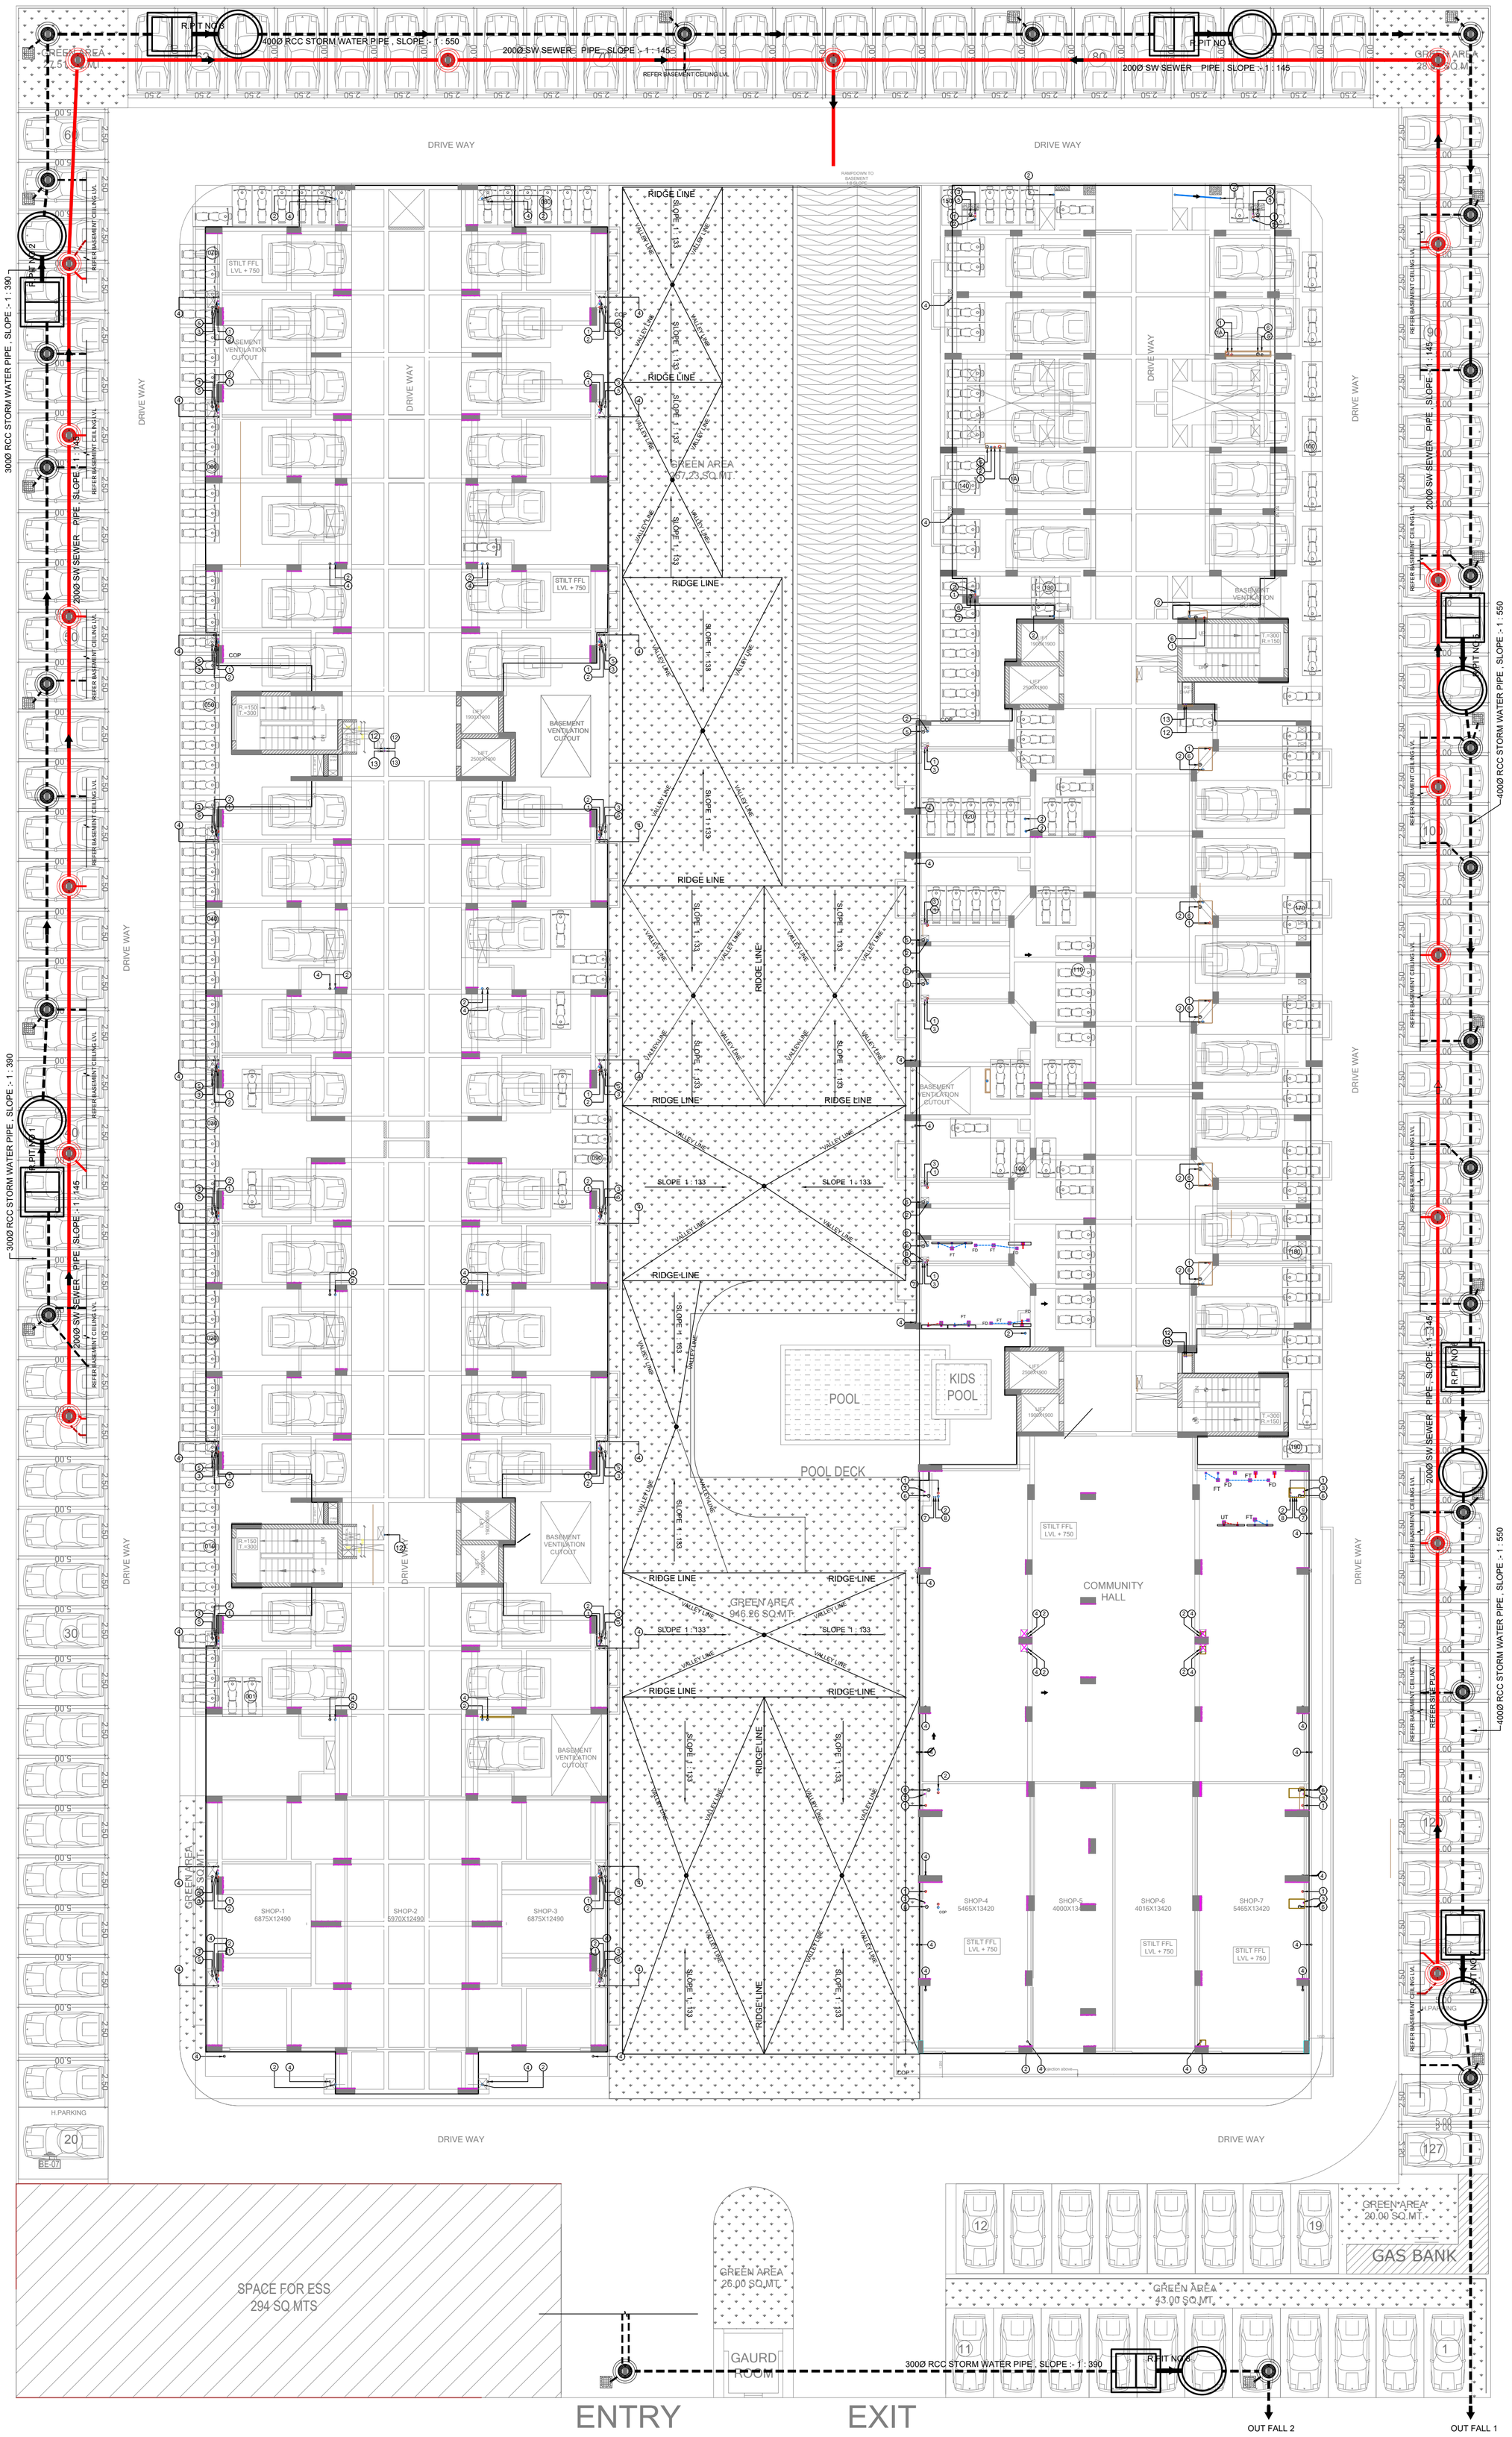

PLUMBING LEGEND

①	110 OD uPVC (SWR) SOIL & VENT PIPE
①A	160 OD uPVC (SWR) SOIL & VENT PIPE
②	110 OD uPVC (SWR) WASTE & VENT PIPE
③	90 OD uPVC ANTISIPHONAGE
④	90 OD uPVC RAIN WATER PIPE
⑤	110 OD uPVC RAIN WATER PIPE
⑥	160 OD uPVC RAIN WATER PIPE
⑦	DOMESTIC WATER SUPPLY DOWN TAKE
⑧	DOMESTIC WATER SUPPLY DOWN TAKE FOR UPPER TWO FLOOR.
⑨	FLUSHING WATER SUPPLY DOWN TAKE
⑩	HOT WATER SUPPLY DOWN TAKE
⑪	HOT WATER SUPPLY DOWN TAKE FOR UPPER TWO FLOOR.
⑫	DOMESTIC WATER SUPPLY RISER
⑬	FLUSHING WATER SUPPLY RISER
⋈	BALL / BUTTER FLY VALVE
FT	FLOOR TRAP (110 x 110 MM)
FD	FLOOR DRAIN (110 x 63 MM)
	DOMESTIC WATER SUPPLY LINE
	FLUSHING WATER SUPPLY LINE
	HOT WATER SUPPLY LINE
R.PIT	RECHARGE PIT SIZE = 7.0 x 1.7 M

NOTES :-

1. ALL SOIL WASTE & VENT PIPES SHALL BE SWR TYPE - B AS PER IS 13592 PIPES WITH RUBBER RING JOINTS ON VERTICAL & SOLVENT CEMENT ON HORIZONTAL.
2. ALL RAIN WATER PIPES SHALL BE SWR TYPE - A AS PER IS 13592 PIPES WITH RUBBER RING JOINTS.
3. SOIL , WASTE & RAIN WATER PIPES > 160 OD SHALL BE uPVC CLASS III (6 KG / SQM.) AS PER IS 4985 WITH SOLVENT CEMENT.
4. WATER SUPPLY PIPES WITH IN TOILETS (HOT & COLD WATER) SHALL BE cPVC GRADE CTS SDR - 11
5. WATER SUPPLY PIPES IN SHAFTS ON TERRACE EXPOSED LOCATION SHALL BE GI.
6. WATER SUPPLY PIPES FROM SOLAR SYSTEM TO TOILETS PIPE SHALL BE cPVC GRADE CTS SDR - 11
7. PIPE FROM FD TO FT = 63 OD uPVC WASTE PIPE
8. PIPE FROM WC TO VERTICAL STACK = 110 OD SWR SOIL PIPE
9. PIPE FROM FT TO VERTICAL STACK = 110 OD SWR WASTE PIPE
10. THE MOUNTING HEIGHT OF DIFFERENT APPLIANCES / TAPS SHALL BE AS UNDER :-

a) WALL MIXTURE (FOR BATHING)	900 M.M.
b) SHOWER	2000 M.M.
c) ANGLE VALVE FOR HEALTH SPRAY(FOR WC)	450 M.M.
d) ANGLE VALVE (FOR WASH BASIN)	450 M.M.
e) WASH BASIN (TOP OF RIM)	780MM OR AS/ARCH.
f) KITCHEN SINK MIXER TABLE MOUNTED	800 M.M
KITCHEN SINK MIXER WALL MOUNTED	150mm FROM SINK TOP
g) ANGLE VALVE (FOR GEYSER)	1500 M.M. / OR AS SPECIFIED
h) ANGLE VALVE (FOR WASHING MACHINE)	750 M.M.
i) ANGLE VALVE (FOR WATER PURIFIER)	950 M.M.

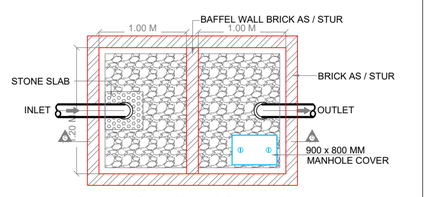

PLAN OF DESILTING CHAMBER
SCALE NTS

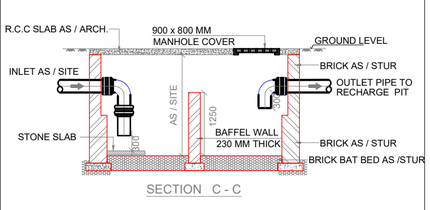

SECTION C - C

ABHA GUPTA
B Tech Civil

DATE	NO.	ISSUED TO	FOR	REVISION
08.06.18	4	CLIENT	CONSTRUCTION	R0
29.08.18	EMAIL	KUSHWAHA JI	CONSTRUCTION	R1
07.10.24	EMAIL	KUSHWAHA JI	CONSTRUCTION	R1
CLIENT				
29.08.18	REVISED FHC LV & ELECTRICAL SHAFT			R1

PLUMBING CONSULTANT

SONI CONSULTANTS
Plumbing & Fire Suppression Consultants
B-2A/139, Janak Puri, New Delhi - 110058
PH - 011 - 25503781 , 41403781
e-mail : info@soniconsultants.in
Website : www.soniconsultants.in

ELECTRICAL CONSULTANT

SS CONSULTANT
D-69 CHATTERPUR ENCLAVE
NEW DELHI-110074
Tel.-011-26302571
E-mail.-ssconsultant2006@gmail.com

OWNER :
DIVINITY BUILD ESTATE Pvt. Ltd.

PROJECT
ARG ANANTA-II WESTWAY HEIGHTS
PROPOSED GROUP HOUSING AT PLOT NO-G-18 WEST WAY HEIGHTS (TRUCK TERMINAL SCHEME , BHANKROTA) SCHEME, JAIPUR

TITLE;;-
Rain Water Harvesting Drawing

ELECTRICAL CONSULTANT

SS CONSULTANT
D-69 CHATTERPUR ENCLAVE
NEW DELHI-110074
Tel.-011-26302571
E-mail.-ssconsultant2006@gmail.com

PLUMBING CONSULTANT

SONI CONSULTANTS
Plumbing & Fire Suppression Consultants
B-2A/139, Janak Puri, New Delhi - 110058
PH - 011 - 25503781 , 41403781
e-mail : info@soniconsultants.in
Website : www.soniconsultants.in

ARCHITECTS

GIAN P. MATHUR AND ASSOCIATES (P) LTD.
C - 55, East Of Kailash, New Delhi-110065
T : 46599599| F 46599512
E : info@gpmindia.com I W : www.gpmindia.com

SCALE : 1 : 125 @A1	DWG. NO.	REV. NO.
DATE : 20.05.2025	ARG-ANT-II-SITE -PL-ST-01	
DEALT : NITIN		
CHK : P.SONI		

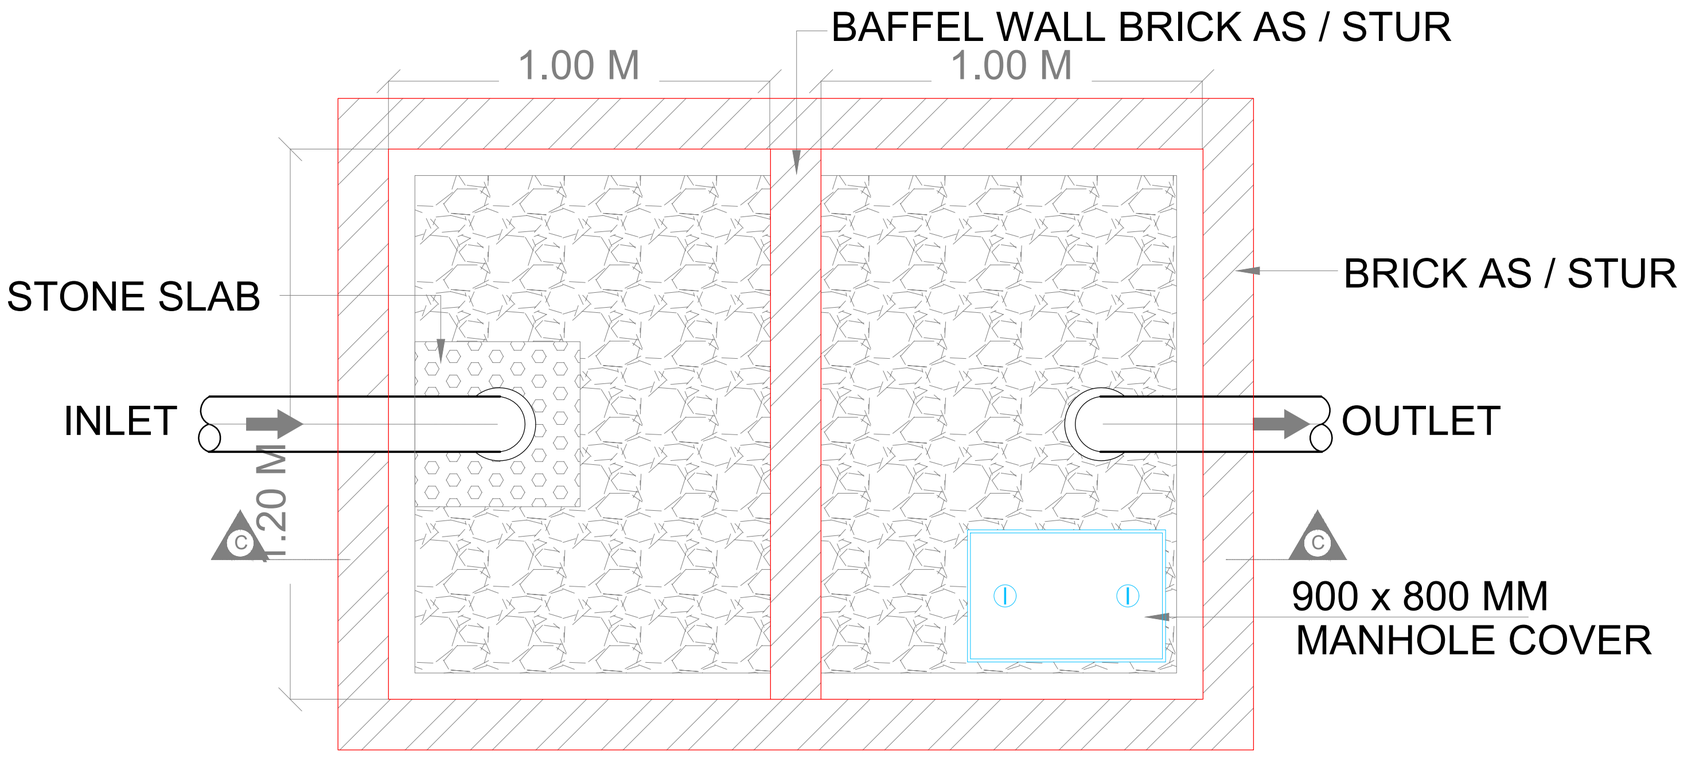

PLAN OF DESILTING CHAMBER

SCALE NTS

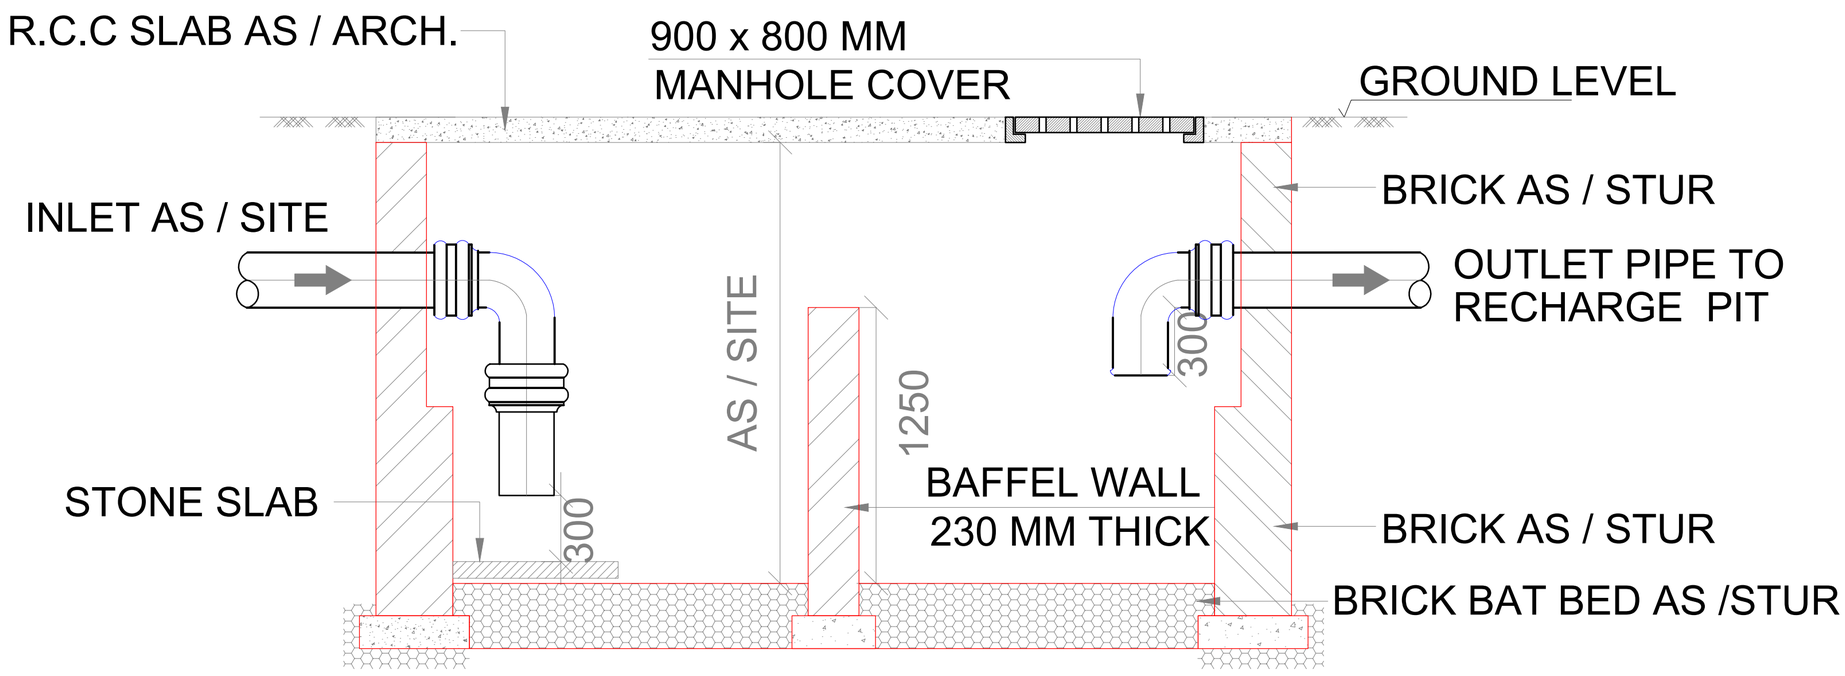

SECTION C - C

ABHA GUPTA
B Tech Civil

DATE	NO.	ISSUED TO	FOR	REVISION
		CLIENT		
29.08.18		REVISED FHC LV & ELECTRICAL SHAFT		R1

PLUMBING CONSULTANT

SONI CONSULTANTS
Plumbing & Fire Suppression Consultants
B-2A/139, Janak Puri, New Delhi - 110058
PH - 011 - 25503781 , 41403781
e-mail : info@soniconsultants.in
Website : www.soniconsultants.in

ELECTRICAL CONSULTANT

SS CONSULTANT
D-69 CHATTERPUR ENCLAVE
NEW DELHI-110074
Tel.-011-26302571
E-mail.-ssconsultant2006@gmail.com

OWNER :

DIVINITY BUILD ESTATE Pvt. Ltd.

PROJECT

ARG ANANTA-II WESTWAY HEIGHTS

PROPOSED GROUP HOUSING AT PLOT NO-G-18 WEST WAY HEIGHTS (TRUCK TERMINAL SCHEME , BHANKROTA) SCHEME, JAIPUR

TITLE;;-

RAIN WATER HARVESTING DETAIL

ELECTRICAL CONSULTANT

SS CONSULTANT
D-69 CHATTERPUR ENCLAVE
NEW DELHI-110074
Tel.-011-26302571
E-mail.-ssconsultant2006@gmail.com

PLUMBING CONSULTANT

SONI CONSULTANTS
Plumbing & Fire Suppression Consultants
B-2A/139, Janak Puri, New Delhi - 110058
PH - 011 - 25503781 , 41403781
e-mail : info@soniconsultants.in
Website : www.soniconsultants.in

ARCHITECTS

GIAN P. MATHUR AND ASSOCIATES (P) LTD.
C - 55, East Of Kailash, New Delhi-110065
T : 46599599 | F 46599512
E : info@gpmindia.com I W : www.gpmindia.com

SCALE : 1 : 125 @A1	DWG. NO.	REV. NO.
DATE : 20.05.2025	ARG-ANT-II-SITE -PL-ST-RWP-01	
DEALT : NITIN		
CHK : P.SONI		